




NON-SPILLABLE

AGM


FP Series are general purpose batteries with 8 years design life in float service. With advanced AGM valve regulated technology and high purity raw material, the FP series batteries ensure high performance and reliable standby service life. They have been designed specifically for applications such as security & alarm systems, UPS, Telecom, power grid, medical equipment and emergency lighting. It can also be used for light cycling use. For intensive cycling, the FPC or FPG cyclic ranges are recommended.

DIMENSIONS & WEIGHT

LENGTH	260±2mm
WIDTH	168±2mm
TOTAL HEIGHT	214±2mm
WEIGHT	18.4kg (tolerance ± 3%)

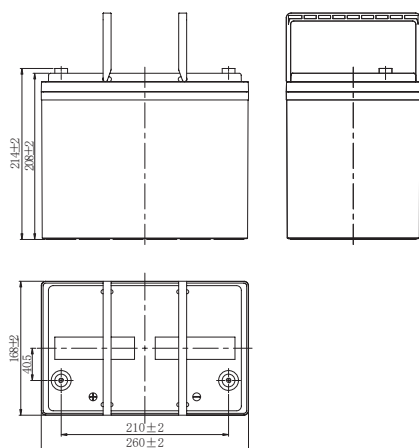

TERMINAL (MM)



SPECIFICATION

Nominal voltage	12V (6 cells)
Nominal capacity	65Ah (20hr)
Design life	8 years at 20°C
Internal resistance	Approx 7.4mΩ
Terminal	T6
Max. discharge current	600A (5 sec)
Reference capacity	65.0Ah (20hr, 1.80V/cell, 25°C/77°F) 60.0Ah (10hr, 1.80V/cell, 25°C/77°F) 54.0Ah (5hr, 1.75V/cell, 25°C/77°F) 49.2Ah (3hr, 1.75V/cell, 25°C/77°F) 37.9Ah (1hr, 1.60V/cell, 25°C/77°F)
Charge voltage	13.5V ~ 13.8V 25°C/77°F
Standby use voltage	Temperature compensation: -10mV/°C/Cell
Cycle use voltage	14.4V ~ 15.0V 25°C/77°F Temperature compensation: -15mV/°C/Cell
Operating temp. range	Discharge: -15°C ~ 50°C Charge: 0°C ~ 40°C Storage: -15°C ~ 40°C
Nominal operating temp. range	25°C ± 3°C / 77°F ± 5°F
Self discharge	Can be stored for up to 6 months at 25°C/77°F and then recharging is recommended. Monthly self-discharge ratio is less than 3% at 25°C/77°F
Capacity affected by temp.	40°C/104°F 103% 25°C/77°F 100% 0°C/32°F 86%
Container material	A.B.S. UL94-HB UL94-V0 optional

APPLICATIONS



Security



UPS



Medical



Telecom



Emergency Lighting



Data Center

APPROVALS

ISO9001 - Quality management system
ISO14001 - Environmental management System
Approved for transport by Air (IATA)
Designed in accordance with IEC 60896-21/22


CONSTANT CURRENT DISCHARGE (AMPERES) AT 25°C/77°F

F.V/Time	5min	10min	15min	20min	30min	45min	1h	2h	3h	4h	5h	6h	8h	10h	20h
1.85V/cell	119.8	85.2	76.2	59.9	53.6	38.8	33.2	20.2	14.8	11.6	10.1	8.90	6.85	5.67	3.01
1.80V/cell	136.3	96.7	86.3	67.7	58.3	41.1	34.4	20.9	16.1	12.4	10.6	9.56	7.20	6.00	3.12
1.75V/cell	148.0	104.9	93.5	73.1	59.5	42.6	36.1	22.0	16.4	12.7	10.8	9.64	7.24	6.03	3.15
1.70V/cell	158.3	111.8	99.3	77.5	60.7	43.4	36.8	22.4	16.7	12.9	11.0	9.69	7.35	6.06	3.18
1.65V/cell	163.8	115.4	102.2	79.7	61.6	44.1	37.3	22.7	16.9	13.1	11.2	9.73	7.45	6.14	3.22
1.60V/cell	169.6	119.3	105.3	81.7	62.5	44.7	37.9	23.1	17.0	13.2	11.4	9.80	7.55	6.21	3.26


CONSTANT POWER DISCHARGE (WATTS/CELL) AT 25°C/77°F

F.V/Time	5min	10min	15min	20min	30min	45min	1h	2h	3h	4h	5h	6h	8h	10h	20h
1.85V/cell	223.8	160.3	149.4	118.0	106.0	74.6	66.5	40.7	30.0	23.6	20.6	17.6	14.1	11.7	6.20
1.80V/cell	250.4	179.3	167.1	132.0	114.5	78.5	68.5	41.8	32.4	25.1	21.6	18.8	14.8	12.2	6.42
1.75V/cell	267.2	191.4	178.3	140.9	115.9	80.8	71.5	43.9	33.0	25.5	21.9	18.9	14.8	12.3	6.48
1.70V/cell	280.9	201.2	187.5	148.1	117.3	81.9	72.6	44.6	33.5	25.9	22.2	19.0	15.0	12.4	6.54
1.65V/cell	285.5	204.5	190.5	150.5	118.1	82.6	73.2	45.0	33.6	26.2	22.5	19.0	15.2	12.6	6.61
1.60V/cell	289.5	207.3	193.2	152.6	118.6	83.0	73.8	45.4	33.8	26.4	22.8	19.1	15.3	12.7	6.68


DISCHARGE CHARACTERISTICS

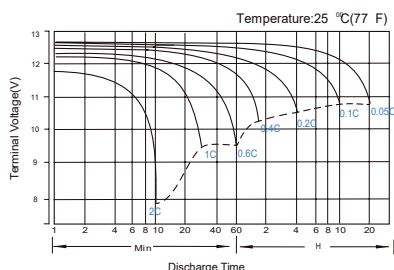


FLOAT CHARGING CHARACTERISTICS

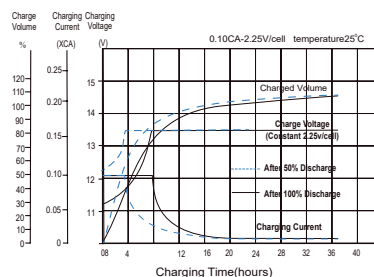


TEMPERATURE EFFECTS IN RELATION TO BATTERY CAPACITY

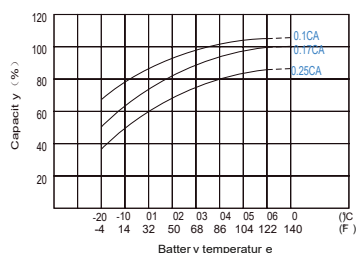


EFFECT OF TEMPERATURE ON LONG TERM FLOAT LIFE

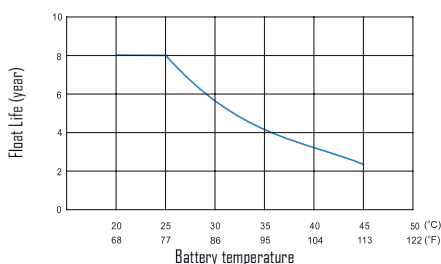

CYCLE LIFE IN RELATION TO DEPTH OF DISCHARGE

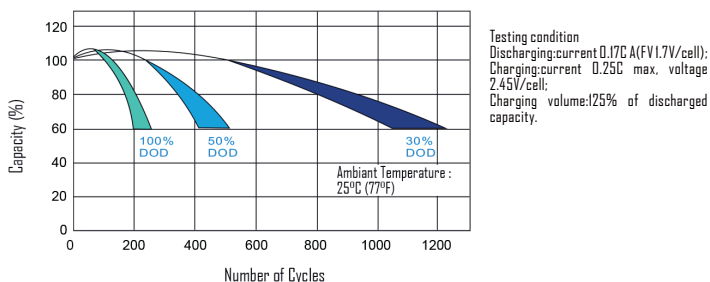

SELF DISCHARGE CHARACTERISTICS

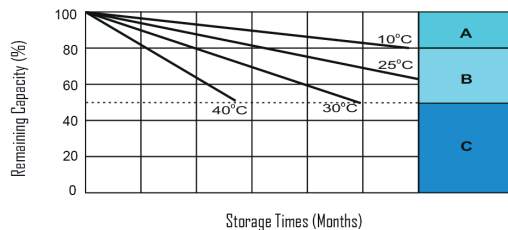

- A** No supplementary charge required (carry out supplementary charge before use if 100% capacity is required)
- B** Supplementary charge required before use. Optional charging way as below:
 1. Charged for above 3 days at limited current 0.25CA and constant voltage 2.25V/cell
 2. Charged for above 20 hours at limited current 0.25CA and constant voltage 2.45V/cell
 3. Charged for 8-10 hours at limited current 0.05CA
- C** Supplementary charge may often fail to recover the capacity. The battery should never be left standing till this is reached